


## PROGRAMMABLE CORRIDOR STATUS

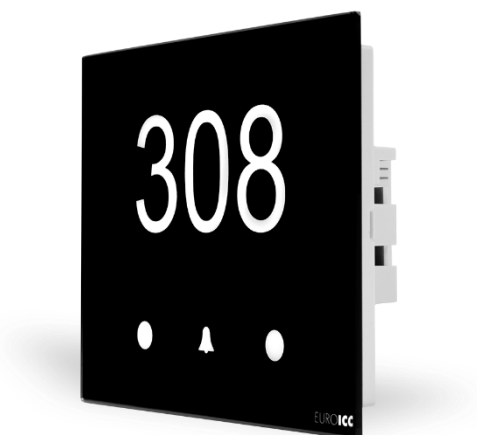

## PRODUCT DESCRIPTION

RG.CSA.01 is a programmable card reader device designed for hotels. This device is placed in corridor next to a room door.

The device provides additional functionality thanks to the 3 capacitive keys and 3 bicolor LED indicators. The device can communicate with Mifare 1K RFID cards.

The RG.CSA.01 communicate with the rest of the system using RS485 port.

## TECHNICAL DATA

ELECTRICAL SPECIFICATIONS	
Power supply	Nominal: 24 VDC, 1 W Voltage range: 12 ... 30 VDC
COMMUNICATION CHANNEL	
RS485	BACnet MS/TP or Modbus Slave RTU/ASCII. Programmable baud rate (9600, 19200, 38400, 76800, 115200), Jumper selectable use of termination and polarization resistors
USB	USB device, mini USB connector, service port
USER INTERFACE	
Room number	YES
Capacitive keys	3
ADDITIONAL SPECIFICATIONS	
Operating temperature	0.. +55 °C
Storage temperature	-30.. +80 °C
Operating humidity	max 95% r.H., no condensation
Protection degree	IP20
Mounting	Wall mounting, for indoor use only
Dimensions	Built in: 72x53x35 mm. Front panel: 130x102x12
Weight	200g


## PRODUCT FEATURES

- » Supports Mifare 1K RFID card
- » Additional functionality provided by capacitive keys and LED indicators
- » Room number has backlight
- » Configuration, programming and debugging is done using PC based tool through USB port
- » Resource sharing between controllers through BACnet network. Data sharing is performed without intervention of the supervisory system
- » Jumper selectable standard polarizing and termination resistors on RS485 terminal

**WIRING AND RESOURCES**

LOCATION	NAME	DESCRIPTION	ADDRESS
Position 1	Power supply 24 VDC -	Device GND	
Position 2	Power supply 24 VDC +	Power supply +	
Position 3	RS485 B-	Communication – line	
Position 4	RS485 A+	Communication + line	
Position 5	NC		
Position 6	NC		
Position 7	NC		
Position 8	NC		
Position 9	NC		
Position 10	NC		
Position 11	NC		
Position 12	NC		
Position 13	NC		
Position 14	NC		
Position 15	NC		
Position 16	NC		

**DIMENSIONS AND MOUNTING**

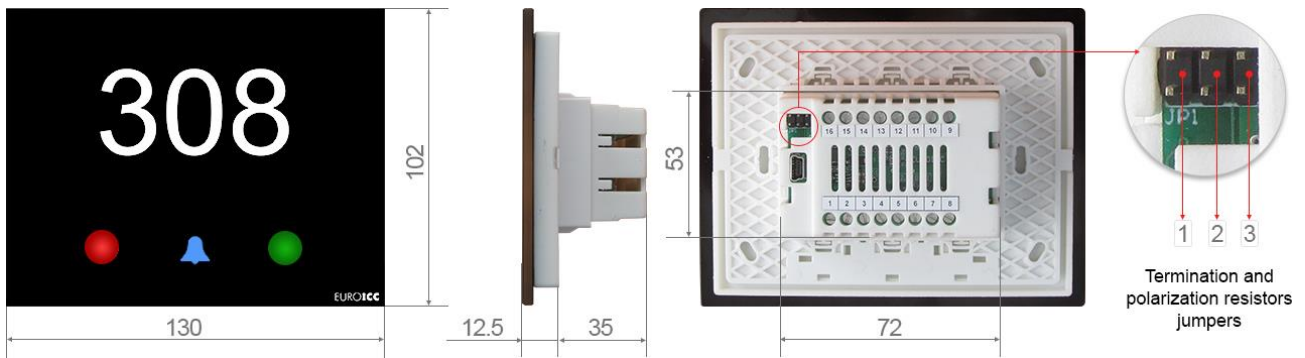

**SAFETY NOTES**



- The device is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- It may only be installed by suitably trained personnel.
- Any legal regulations or regulations issued by authorities must be observed during assembly.
- The device may only be opened at the manufacturer’s site. It does not contain any parts that can be replaced or repaired by the user.
- The device contains electrical and electronic components and is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.